

ADDENDUM #1
October 17, 2005

ARCHITECT

A3 Studio
343 West Water St.
Kerrville, TX 78028

PROJECT

Kerrville Schreiner Park
Renovations
2385 Bandera Road
Kerrville, Texas 78028

OWNER

City of Kerrville
800 Junction Highway
Kerrville, Texas 78028

This addendum forms a part of the Contract Documents and modifies the original specifications and drawings dated October 3, 2005. Acknowledge receipt of this addendum in all proposals to the Owner. Failure to do so may subject the bidder to disqualification.

Addendum Items:

1. Sheet A-1: Revise paths from Shelter #3 and #4 to avoid accessible route traveling behind parked cars. Refer to revised sketch SK-01, enclosed.
2. Sheet A-1: Add 5' x 5' crushed granite passing area at a mid point along the 230' (+-) crushed granite path to the restrooms.
3. Sheet A-1: Change note on curb ramp at restroom building to read "... grooves to be 2" o.c....")
4. Sheet A-1: Restroom building: Revise keyed note #17 to read: Existing screen wall outside both Men and Women restrooms is to be relocated so that a minimum of 4'-6" clearance is maintained on the entry walk between the screen wall and the building. Change side walk width to 5'-0" where shown to accommodate screen wall. Provide new wood framing, painted finish to match existing at screen wall extension. Provide similar detail for anchorage into existing concrete and overhead bracing. Refer to enclosed sketch SK-02.
5. Sheet A-1: Revise keyed note #8 to read: " Add new concrete sidewalk (hatched area on plan) at 1:20 slope....."
6. Sheet A-1: Restroom building: Revise keyed note #7 to read: "Remove existing concrete sidewalk. Dashed area on plan indicates area to be removed".
7. Sheet A-1: Add the following note: In both Men's and Women's restrooms, the shower controls shall be located off center towards the open side of the shower, mounted at 42" a.f.f. to the center of the controls. The shower hose shall be 60" long.


8. Sheet A-2: Detail 2, Screened Shelter Building Section: Change roof insulation from R-13 Kraft faced batt insulation to polycynene blown in insulation, by Icynene, or equal. Insulation to be to full depth of 2x4 rafters, completely filling all voids. Installation shall be in strict accordance with manufacturer's instructions.



10.17.05

End of Addendum #1

EXISTING ROAD

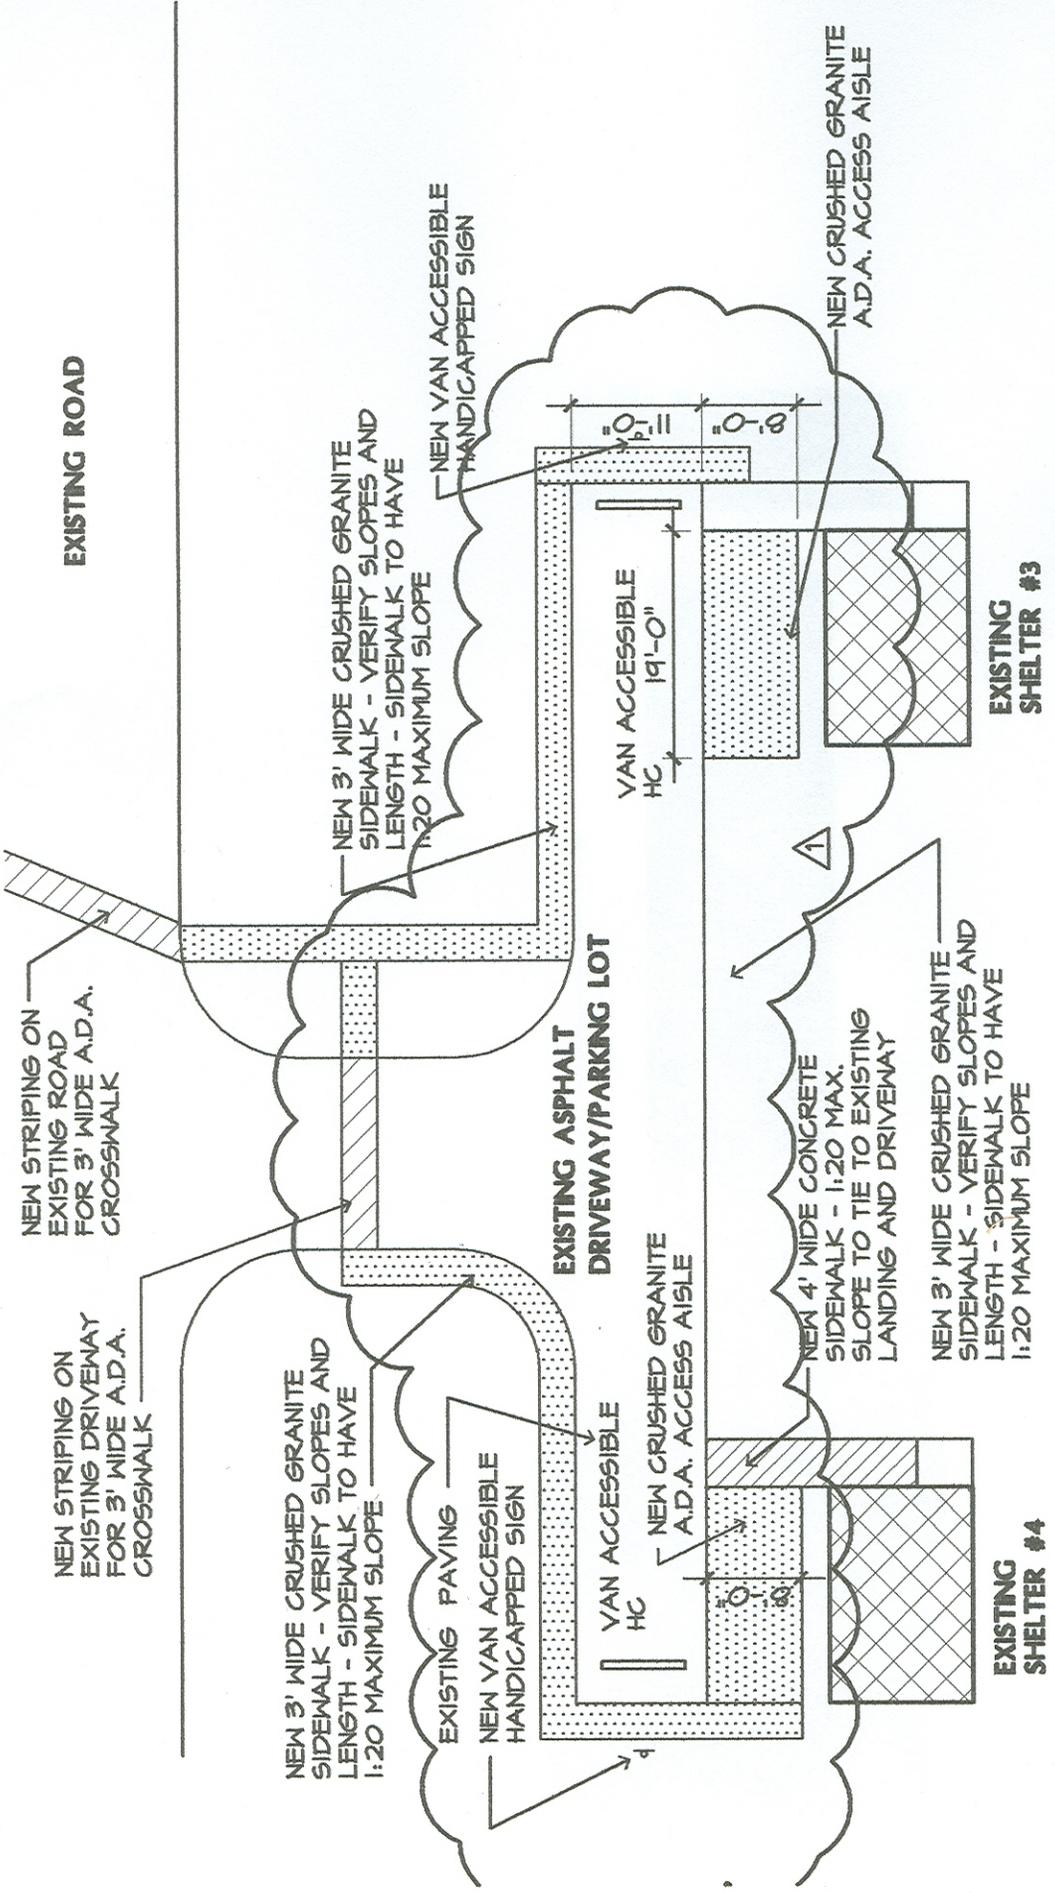

10-17-05



PARTIAL- SHEET A-1

ADDENDUM #1

10-17-05

SKETCH #

SK-01

PLAN NORTH



**KERRVILLE SCHREINER PARK
RENOVATIONS**
KERRVILLE, TEXAS

2 Site Plan
Scale: 1/16" = 1'-0"

**KERRVILLE
SCHREINER PARK
RENOVATIONS**
KERRVILLE, TEXAS

ADDENDUM #1

10-17-05

SKETCH #

SK-02

1

Floor Plan

Scale: 1/4" = 1'-0"

PLAN
NORTH



A Studio

PARTIAL- SHEET A-1

